

**TEST REPORT**  
for  
**JACKSON ACOUSTICS**  
**Sound Absorption Testing**  
ISO 354:2003  
On


**Slat Panel (1D)  
Type A Mounting**


Report Number: NGC 4024037

Assignment Number: G-1933

Test Date: 12/05/2024

Report Approval Date: 12/13/2024

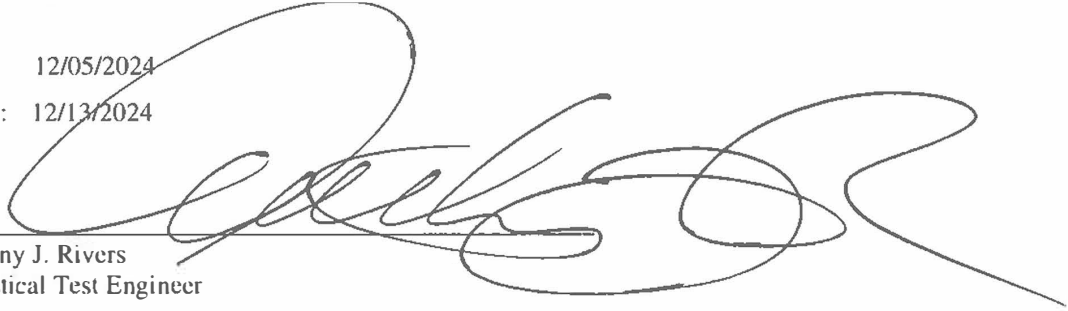Submitted by:   
Anthony J. Rivers  
Acoustical Test Engineer

Reviewed by:   
Michael J. Rizzo  
General Manager

The results reported above apply to specific samples submitted for measurement. No responsibility is assumed for performance of any other specimen. The laboratory's accreditation or any of its test reports in no way constitute or imply product certification, approval, or endorsement by NVLAP or any agent of the U.S. Government. This report may not be reproduced except in full, without written approval of the laboratory.

**Revision Summary:**

Date	SUMMARY
Approval Date: 12/13/2024	Original issue date: 12/13/2024 Original NGCTS report: NGC 4024037

The results reported above apply to specific samples submitted for measurement. No responsibility is assumed for performance of any other specimen. The laboratory's accreditation or any of its test reports in no way constitute or imply product certification, approval, or endorsement by NVLAP or any agent of the U.S. Government. This report may not be reproduced except in full, without written approval of the laboratory.

Report Number: NGC 4024037

Test Method: This test method conforms explicitly with the American Society for Testing and Materials Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method - Designation: ISO 354:2003.

For the test, a Linear Averaging Mode is used as the Averaging Algorithm when measuring the Decay Times.

Specimen Description: Designated by client as: Slat Panel (1D). This panel is a fabric acoustic panel with a rectangular slat diffuser on the front. The diffuser includes rectangular slats removed in a specific pattern, offering sound diffusion along with absorption.

The test specimen was observed to have the following characteristics:

Panel Identification: Slat Panel (1D). This panel is a fabric acoustic panel with a rectangular slat diffuser on the front. The diffuser includes rectangular slats removed in a specific pattern, offering sound diffusion along with absorption.

All weights and dimension are averaged:

Measured dimensions:

Weight: 9.47 kg/m<sup>2</sup> (1.94 PSF)

Thickness: 59.18 mm (2.33 in.)

Mounting: Type A as per ISO 354:2003

Total Sample Size: 109.88 Sq. Ft. (10.21 m<sup>2</sup>)

Preconditioning: Minimum 24 hours at 70°F, 55% R.H

Test Results: The results of the tests are given on pages 4 and 5 of the report.

The results reported above apply to specific samples submitted for measurement. No responsibility is assumed for performance of any other specimen. The laboratory's accreditation or any of its test reports in no way constitute or imply product certification, approval, or endorsement by NVLAP or any agent of the U.S. Government. This report may not be reproduced except in full, without written approval of the laboratory.


Sound Absorption Test Data per ISO 354:2003					Page 4 of 5
No. of test report:		NGC4024037		Date of test: 12/5/2024	
Temp. [°C]: 25.0		Humidity [%]: 50		Spec. Size [m <sup>2</sup> ]: 10.210	
Frequency [Hz]	Absorption Coefficients a <sub>s</sub>	Avg. Decay Rate			
		Empty d (empty) [dB/s]	Specimen d (specimen) [dB/s]		
100	0.23	8.54	11.61		
125	0.28	9.81	13.57		
160	0.28	8.33	12.12		
200	0.61	7.69	15.99		
250	0.61	7.90	16.19		
315	0.83	7.35	18.62		
400	1.03	6.91	20.90		
500	1.01	6.74	20.44		
630	0.96	6.75	19.74		
800	0.94	6.56	19.37		
1000	0.86	6.75	18.43		
1250	0.79	7.39	18.07		
1600	0.83	7.71	19.05		
2000	0.78	8.83	19.47		
2500	0.73	9.14	19.11		
3150	0.67	9.62	18.78		
4000	0.65	9.53	18.42		
5000	0.64	9.40	18.08		
Reverberation Room Volume:		282.1		m <sup>3</sup>	

The results reported above apply to specific samples submitted for measurement. No responsibility is assumed for performance of any other specimen. The laboratory's accreditation or any of its test reports in no way constitute or imply product certification, approval, or endorsement by NVLAP or any agent of the U.S. Government. This report may not be reproduced except in full, without written approval of the laboratory.

**Sound Absorption Test Data per ISO 354:2003**

Test report: **NGC4024037**  
 Date of test: 12/5/2024  
 Spec. Size [n 10.21  
 Room Vol.[m 282.1  
 Temp. [°C]: 25.0  
 Humidity [%] 50

Frequency [Hz]	Absorption Coefficients $\alpha_s$
100	0.23
125	0.28
160	0.28
200	0.61
250	0.61
315	0.83
400	1.03
500	1.01
630	0.96
800	0.94
1000	0.86
1250	0.79
1600	0.83
2000	0.78
2500	0.73
3150	0.67
4000	0.65
5000	0.64

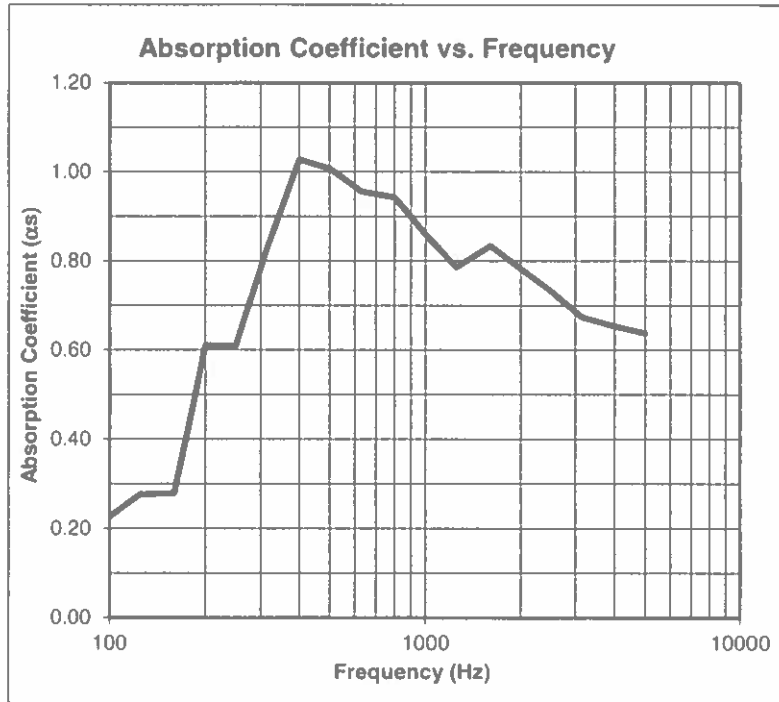

The results reported above apply to specific samples submitted for measurement. No responsibility is assumed for performance of any other specimen. The laboratory's accreditation or any of its test reports in no way constitute or imply product certification, approval, or endorsement by NVLAP or any agent of the U.S. Government. This report may not be reproduced except in full, without written approval of the laboratory.